


Trim Single Wall Day Tanks With 25 To 100 Gallons Capacity

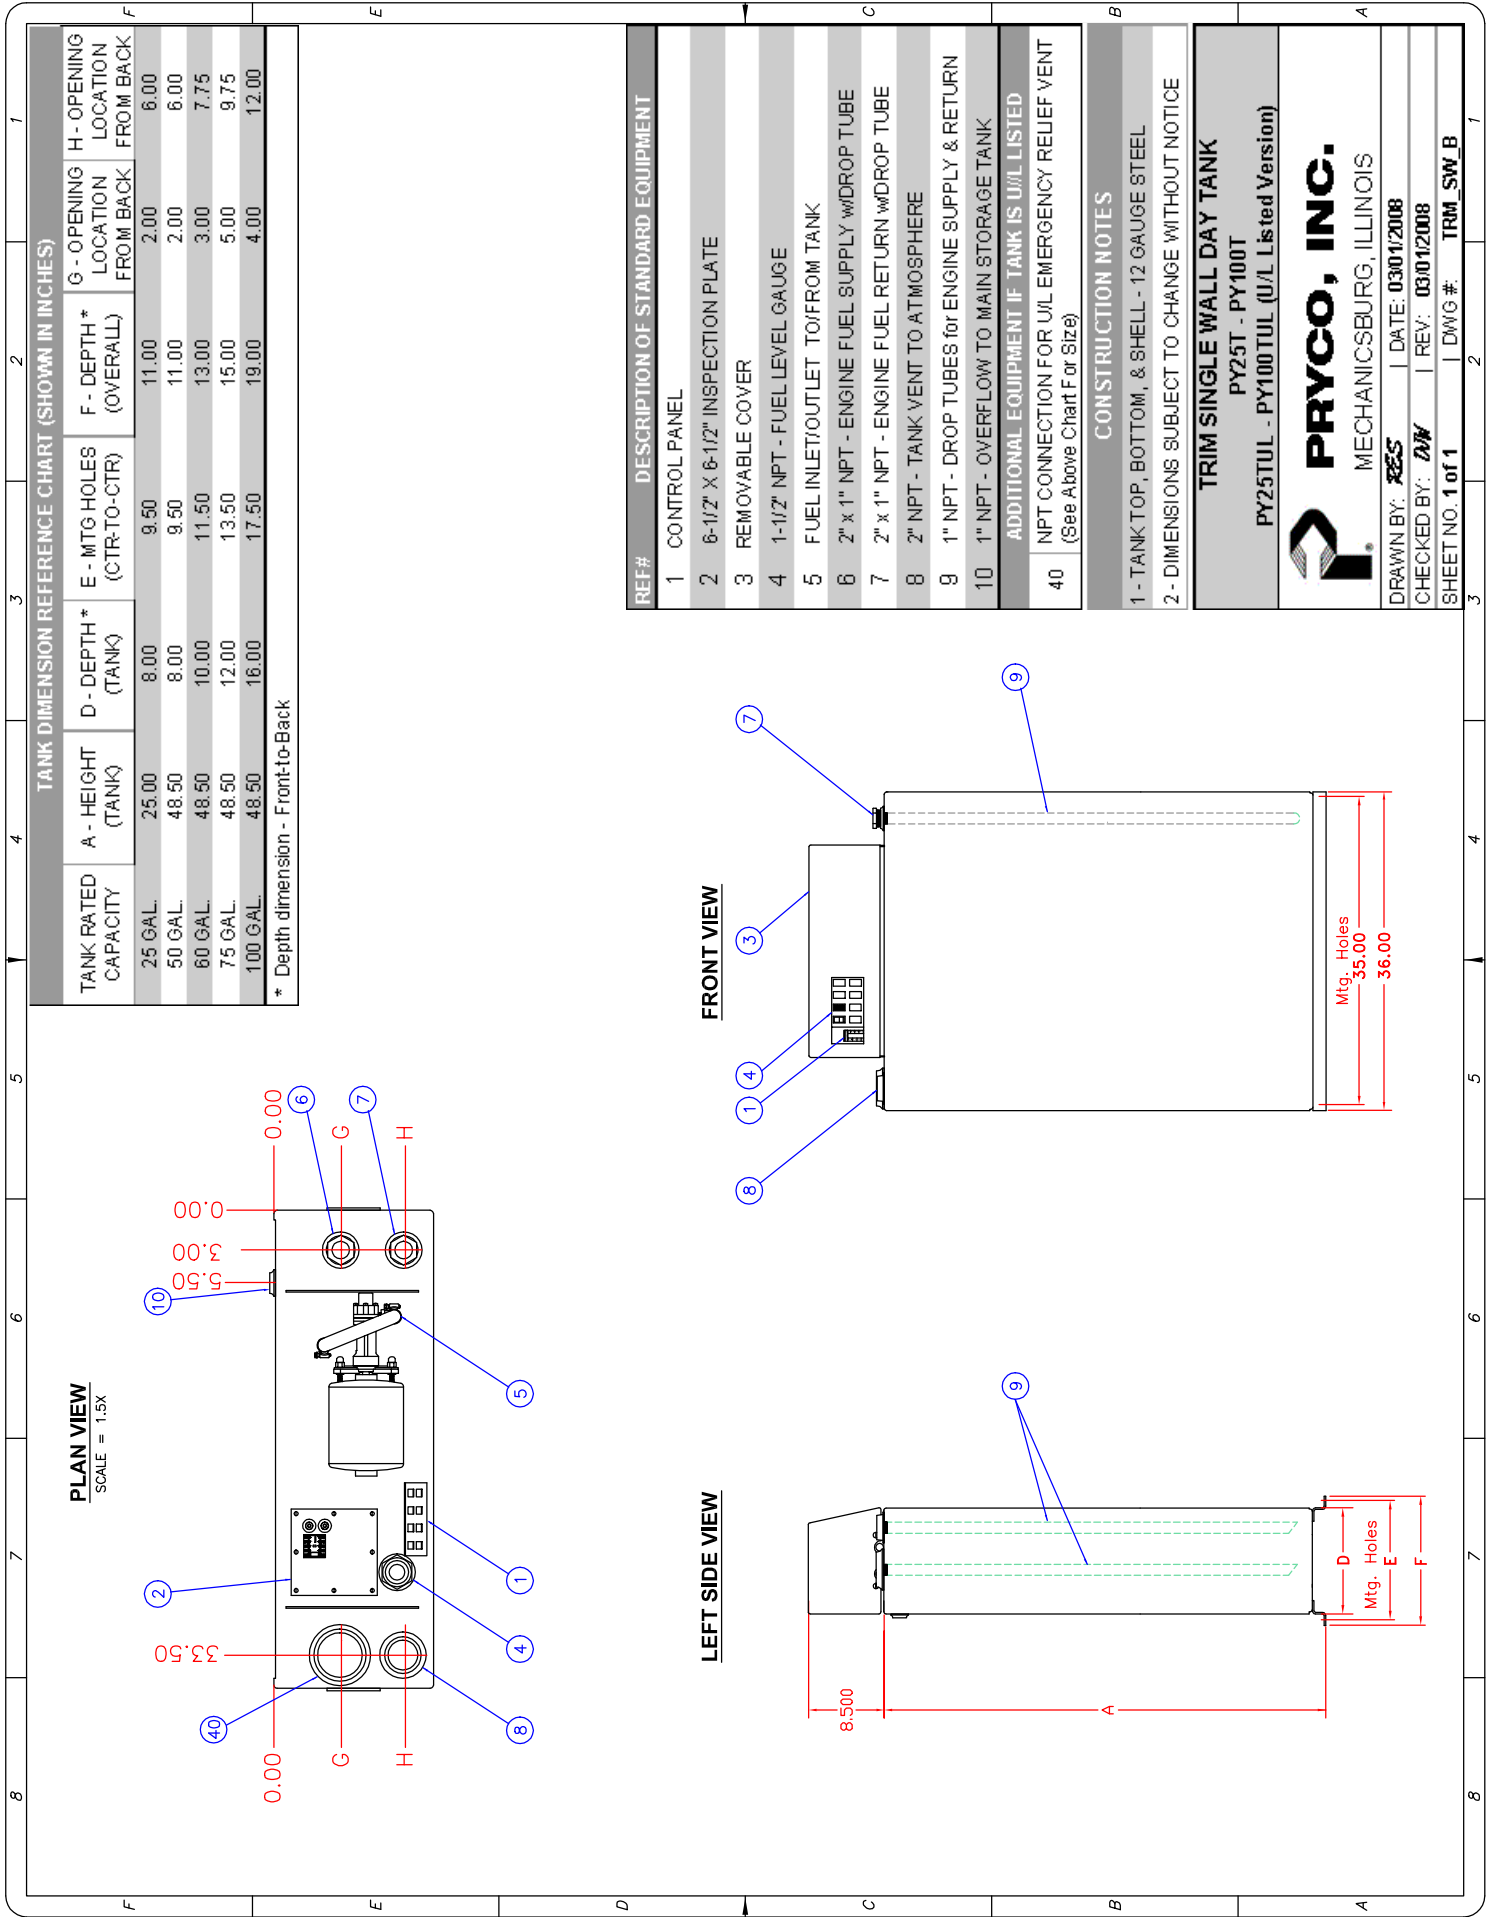

TANK DIMENSION REFERENCE CHART (SHOWN IN INCHES)

TANK RATED CAPACITY	A - HEIGHT (TANK)	D - DEPTH* (TANK)	E - MTS HOLES (CTR-TO-CTR)	F - DEPTH* (OVERALL)	G - OPENING LOCATION FROM BACK	H - OPENING LOCATION FROM BACK
25 GAL.	25.00	8.00	9.50	11.00	2.00	6.00
50 GAL.	48.50	8.00	9.50	11.00	2.00	6.00
60 GAL.	48.50	10.00	11.50	13.00	3.00	7.75
75 GAL.	48.50	12.00	13.50	15.00	5.00	9.75
100 GAL.	48.50	16.00	17.50	19.00	4.00	12.00

* Depth dimension - Front-to-Back

DESCRIPTION OF STANDARD EQUIPMENT

1	CONTROL PANEL
2	6-1/2" X 8-1/2" INSPECTION PLATE
3	REMOVABLE COVER
4	1-1/2" NPT - FUEL LEVEL GAUGE
5	FUEL INLET/OUTLET TO/FROM TANK
6	2" x 1" NPT - ENGINE FUEL SUPPLY w/DROP TUBE
7	2" x 1" NPT - ENGINE FUEL RETURN w/DROP TUBE
8	2" NPT - TANK VENT TO ATMOSPHERE
9	1" NPT - DROP TUBES FOR ENGINE SUPPLY & RETURN
10	1" NPT - OVERFLOW TO MAIN STORAGE TANK

ADDITIONAL EQUIPMENT IF TANK IS U/L LISTED

40	NPT CONNECTION FOR U/L EMERGENCY RELIEF VENT (See Above Chart F or Size)
----	--

CONSTRUCTION NOTES

- TANK TOP, BOTTOM, & SHELL - 12 GAUGE STEEL
- DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE

TRIM SINGLE WALL DAY TANK
 PY25T - PY100T
 PY25TUL - PY100TUL (U/L Listed Version)

PRYCO, INC.
 MECHANICSBURG, ILLINOIS

DRAWN BY: **RES** | DATE: **03/01/2008**
 CHECKED BY: **JAW** | REV: **03/01/2008**

SHEET NO. **1 of 1** | DWG # **TRM_SW_B**