




FRONT VIEW

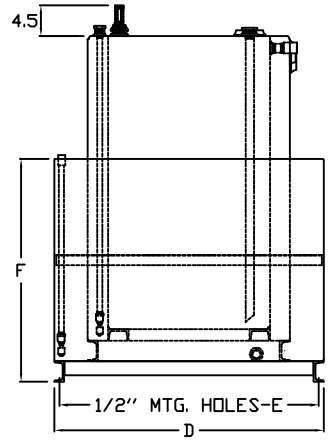


RIGHT SIDE VIEW

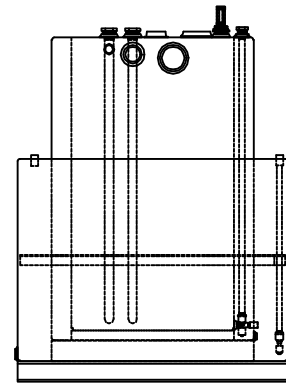

REAR VIEW

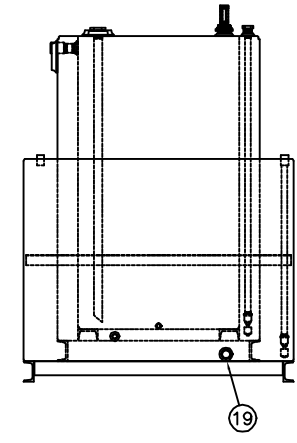

LEFT SIDE VIEW

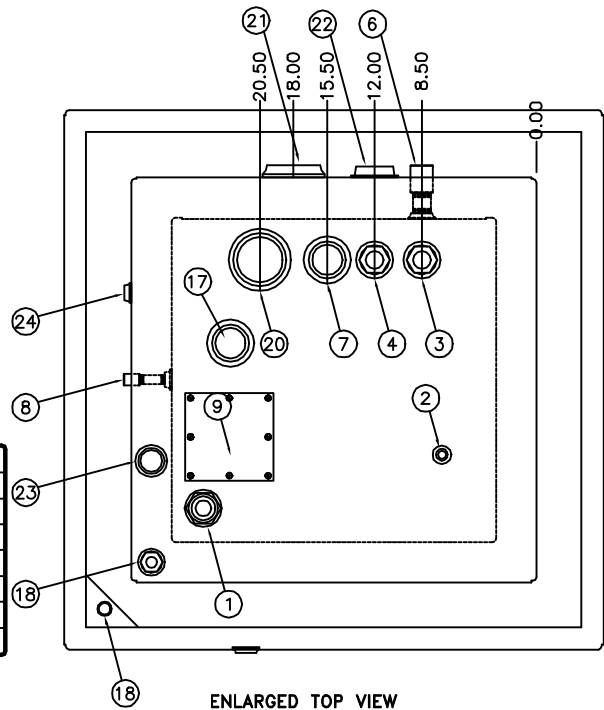

ENLARGED TOP VIEW

DIM.	50 GAL.	60 GAL.	75 GAL.	100 GAL.	150 GAL.
A	38.00	46.00	51.00	51.00	51.00
B	40.00	40.00	40.00	40.00	40.00
C	38.50	38.50	38.50	38.50	38.50
D	34.00	34.00	34.00	40.00	53.00
E	32.50	32.50	32.50	38.50	40.00
F	21.00	25.00	29.00	33.00	36.00
VENT	2"	3"	3"	3"	3"

DESCRIPTION OF STANDARD EQUIPMENT	
1	1 1/2" NPT FOR FUEL LEVEL GAUGE
2	3/8" NPT FUEL INLET TO TANK
3	1 1/2" X 1" NPT ENGINE FUEL SUPPLY
4	1 1/2" X 1" NPT ENGINE FUEL RETURN
5	1" NPT PIPE STEMS FOR ENGINE FUEL SUPPLY & RETURN
6	1" NPT OVERFLOW TO MAIN STORAGE TANK
7	2" NPT ATMOSPHERIC VENT FOR TANK
8	3/8" NPT TANK DRAIN
9	6 1/2" X 6 1/2" REMOVABLE INSPECTION PLATE
17	2" NPT FOR MANUAL FILL
18	NPT FOR OPTIONAL LEAK DETECTOR
19	1" NPT RUPTURE BASIN DRAIN
22	2" NPT ATMOSPHERIC VENT FOR DOUBLE WALL
23	1 1/4" NPT FOR DOUBLE WALL INSPECTION (PLUGGED)
24	3/8" NPT DOUBLE WALL DRAIN

ADDITIONAL EQUIPMENT FOR U/L LISTED	
20	U/L EMERGENCY RELIEF VENT FOR TANK (SEE CHART)
21	U/L EMERGENCY RELIEF VENT FOR DOUBLE WALL (SEE CHART)

CONSTRUCTION NOTES
 TANK TOP,BOTTOM & SHELL - 12 GAUGE
 DOUBLE WALL TOP,BOTTOM & SHELL - 12 GAUGE
 DIMENSION SUBJECT TO CHANGE WITHOUT NOTICE

MANUAL DAY TANK
 PY50 - PY150 (50-150 GALLONS)
 WITH DOUBLE WALL & RUPTURE BASIN



DIMENSIONS IN INCHES	DRAWN BY: RES	SHEET NO: 1 OF 1
	CHECKED BY: R.J.W.	SCALE: 1 = 25
	DATE: 07-20-2000	DWG NUMBER:MAN-B DW RB