


DIM.	50 GAL.	60 GAL.	75 GAL.	100 GAL.	150 GAL.
A	36.50	46.0	52.50	52.0	52.0
B	40.0	40.0	40.0	40.0	40.0
C	38.50	38.50	38.50	38.50	38.50
D	34.0	34.0	34.0	40.0	53.0
E	32.50	32.50	32.50	38.50	51.50
F	21.0	23.0	29.0	33.0	36.0
VENT	2"	3"	3"	3"	3"

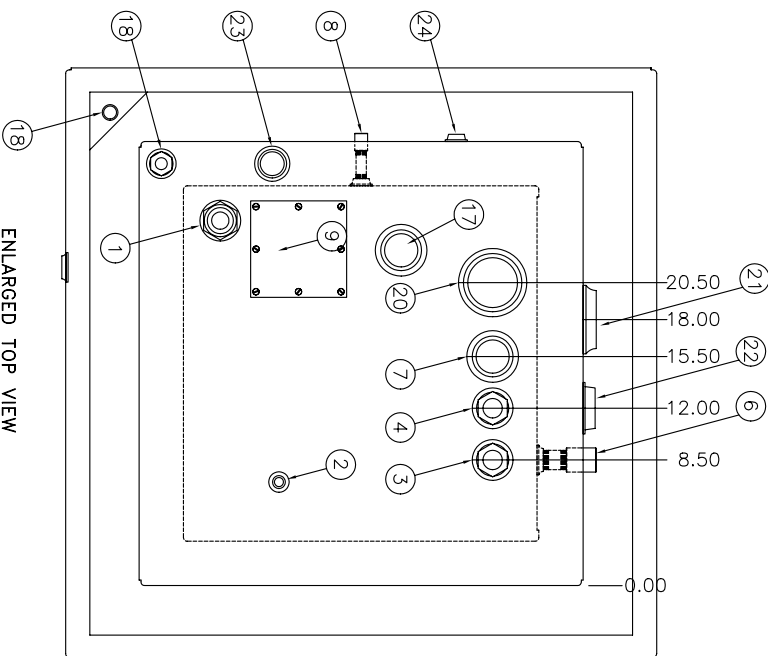

DESCRIPTION OF STANDARD EQUIPMENT

1	1 1/2" NPT FOR FUEL LEVEL GAUGE
2	3/8" NPT FUEL INLET TO TANK
3	1 1/2" X 1" NPT ENGINE FUEL SUPPLY
4	1 1/2" X 1" NPT ENGINE FUEL RETURN
5	1" NPT PIPE STEMS FOR ENGINE FUEL SUPPLY & RETURN
6	1" NPT OVERFLOW TO MAIN STORAGE TANK
7	2" NPT ATMOSPHERIC VENT FOR TANK
8	3/8" NPT TANK DRAIN
9	6 1/2" X 6 1/2" REMOVABLE INSPECTION PLATE
17	2" NPT FOR MANUAL FILL
18	NPT FOR OPTIONAL LEAK DETECTOR
19	1" NPT RUPTURE BASIN DRAIN
22	2" NPT ATMOSPHERIC VENT FOR DOUBLE WALL
23	1 1/4" NPT FOR DOUBLE WALL INSPECTION (PLUGGED)
24	3/8" NPT DOUBLE WALL DRAIN

ADDITIONAL EQUIPMENT FOR U/L LISTED

20	U/L EMERGENCY RELIEF VENT FOR TANK (SEE CHART)
21	U/L EMERGENCY RELIEF VENT FOR DOUBLE WALL (SEE CHART)

CONSTRUCTION NOTES

- TANK TOP,BOTTOM & SHELL - 12 GAUGE
- DOUBLE WALL TOP,BOTTOM & SHELL - 12 GAUGE
- DIMENSION SUBJECT TO CHANGE WITHOUT NOTICE

MANUAL DAY TANK
 PY50 - PY150 (50-150 GALLONS)
 WITH DOUBLE WALL & 200% RUPTURE BASIN



DIMENSIONS IN INCHES

DRAWN BY: RES

CHECKED BY: R.J.W.

DATE: 07-20-2000

SHEET NO: 1 OF 1

SCALE: 1 = 25

DWG.#: MAN-B DW RB 200%