




FRONT VIEW

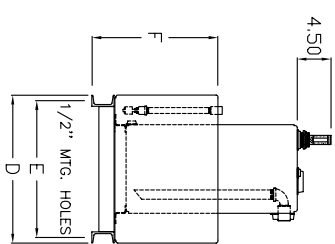


RIGHT SIDE VIEW



REAR VIEW

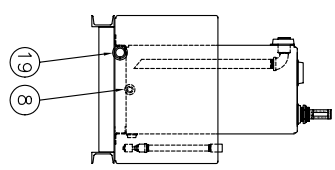

LEFT SIDE VIEW

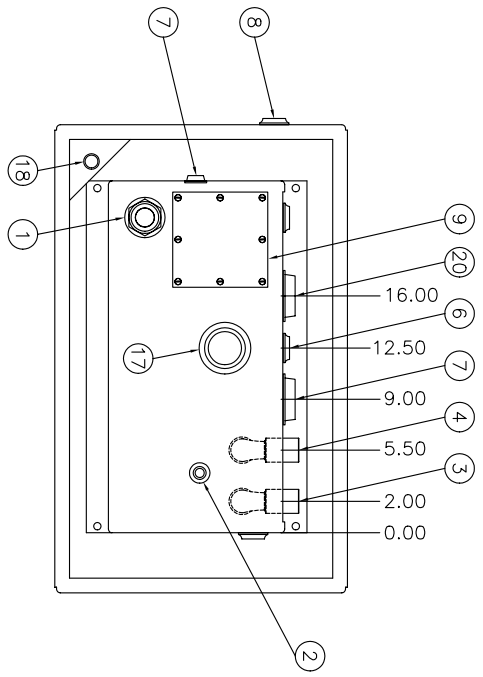

ENLARGED TOP VIEW

DIM.	10 GAL.	15 GAL.	25 GAL.
A	17.0	23.0	28.0
B	38.0	38.0	40.0
C	36.50	36.50	38.50
D	22.0	22.0	28.0
E	20.50	20.50	26.50
F	11.0	12.0	14.0
VENT	2"	2"	2"

DESCRIPTION OF STANDARD EQUIPMENT

- 1 1 1/2" NPT FOR FUEL LEVEL GAUGE
- 2 3/8" NPT FUEL INLET TO TANK (PLUGGED)
- 3 1" NPT ENGINE FUEL SUPPLY
- 4 1" NPT ENGINE FUEL RETURN
- 5 1" NPT PIPE STEMS FOR FUEL SUPPLY & RETURN
- 6 1" NPT OVERFLOW TO MAIN STORAGE TANK
- 7 2" NPT ATMOSPHERIC VENT FOR TANK
- 8 1/4" NPT TANK DRAIN
- 9 6 1/2" X 6 1/2" REMOVABLE INSPECTION PLATE
- 17 2" NPT FOR MANUAL FILL
- 18 1/2" NPT FOR OPTIONAL RUPTURE BASIN LEAK DETECTOR
- 19 1" NPT RUPTURE BASIN DRAIN

ADDITIONAL EQUIPMENT FOR U/L LISTED

- 20 2" NPT U/L EMERGENCY RELIEF VENT FOR TANK

CONSTRUCTION NOTES

- TANK TOP, BOTTOM & SHELL - 12 GAUGE
- RUPTURE BASIN BOTTOM & SHELL - 12 GAUGE
- DIMENSION SUBJECT TO CHANGE WITHOUT NOTICE

MANUAL DAY TANK
 PY10 - PY25 (10-25 GALLONS)
 WITH 200% RUPTURE BASIN



DIMENSIONS IN INCHES	DRAWN BY: RES	SHEET NO: 1 OF 1
	CHECKED BY: D.J.W.	SCALE: 1 = 25
	DATE: 07-20-2000	DWG.#: MAN-A SW RB 200%