




FRONT VIEW

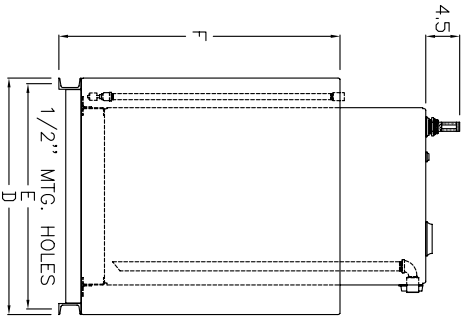


RIGHT SIDE VIEW

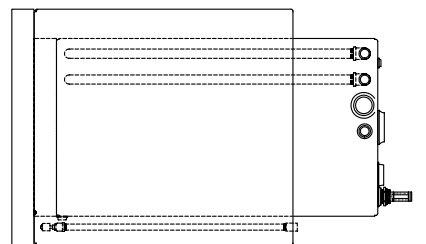

REAR VIEW

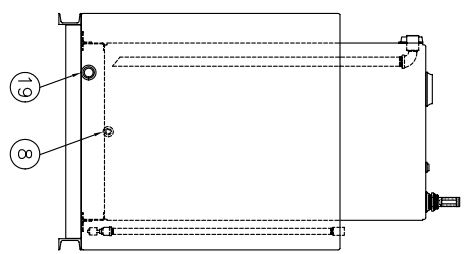

LEFT SIDE VIEW

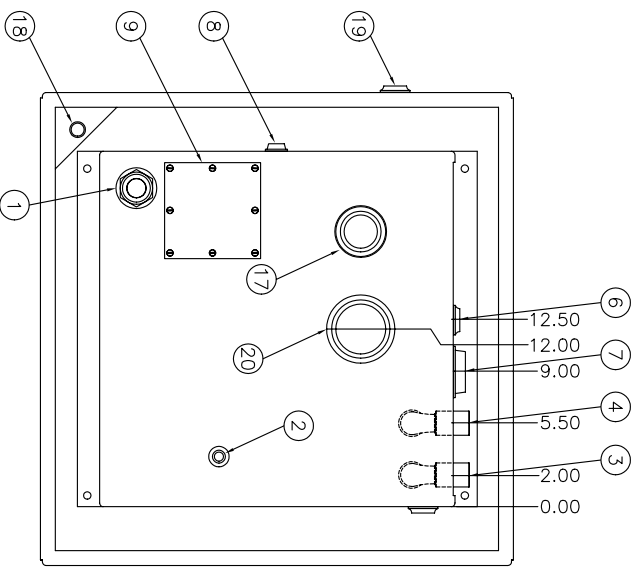

ENLARGED TOP VIEW

DIM.	50 GAL.	60 GAL.	75 GAL.	100 GAL.	150 GAL.
A	36.50	44.50	49.50	49.5	49.50
B	40.0	40.0	40.0	40.0	40.0
C	38.50	38.50	38.50	38.50	38.50
D	34.0	34.0	34.0	40.0	53.0
E	32.50	32.50	32.50	38.50	51.50
F	21.0	24.0	29.0	33.0	36.0
VENT	2"	3"	3"	3"	3"

**DESCRIPTION OF STANDARD EQUIPMENT**

- 1 1 1/2" NPT FOR FUEL LEVEL GAUGE
- 2 3/8" NPT FUEL INLET TO TANK
- 3 1 1/2" X 1" NPT ENGINE FUEL SUPPLY
- 4 1 1/2" X 1" NPT ENGINE FUEL RETURN
- 5 1" NPT PIPE STEMS FOR ENGINE FUEL SUPPLY & RETURN
- 6 1" NPT OVERFLOW TO MAIN STORAGE TANK
- 7 2" NPT ATMOSPHERIC VENT FOR TANK
- 8 3/8" NPT TANK DRAIN
- 9 6 1/2" X 6 1/2" REMOVABLE INSPECTION PLATE
- 17 2" NPT FOR MANUAL FILL
- 18 1 1/2" NPT FOR OPTIONAL RUPTURE BASIN LEAK DETECTOR
- 19 1" NPT RUPTURE BASIN DRAIN

**ADDITIONAL EQUIPMENT FOR U/L LISTED**

20 U/L EMERGENCY RELIEF VENT FOR TANK (SEE CHART FOR SIZE)

**CONSTRUCTION NOTES**

- TANK TOP,BOTTOM & SHELL - 12 GAUGE
- RUPTURE BASIN BOTTOM & SHELL - 12 GAUGE
- DIMENSION SUBJECT TO CHANGE WITHOUT NOTICE

MANUAL DAY TANK  
 PY50 - PY150 (50-150 GALLONS)  
 WITH 200% RUPTURE BASIN



DIMENSIONS IN INCHES  
 DRAWN BY: RES SHEET NO: 1 OF 1  
 CHECKED BY: D.J.W. SCALE: 1 = 25  
 DATE: 07-20-2000 DWG.#: MAN-B SW RB 200%