




FRONT VIEW

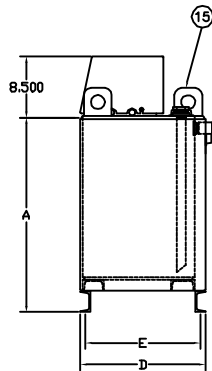


RIGHT SIDE VIEW

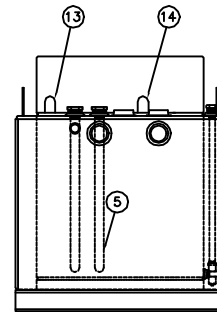

REAR VIEW

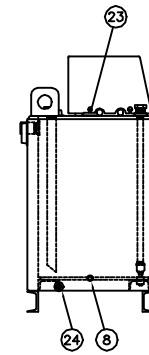

LEFT SIDE VIEW

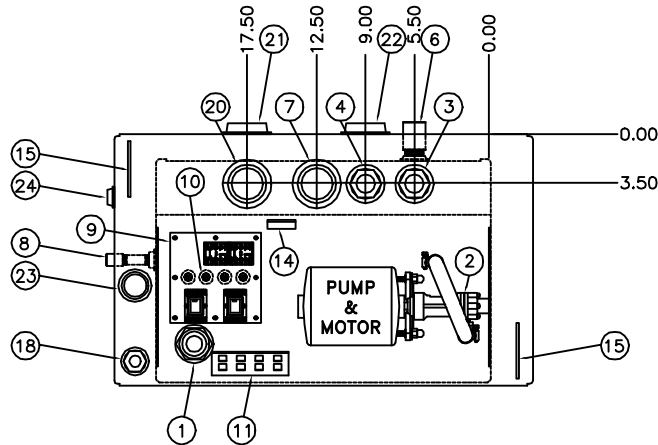

DIM.	10 GAL.	15 GAL.	25 GAL.
A	17.00	23.00	28.00
B	30.00	30.00	30.00
C	28.50	28.50	28.50
D	18.00	18.00	18.00
E	16.50	16.50	16.50
VENT	2"	2"	2"

DESCRIPTION OF STANDARD EQUIPMENT

1	1 1/2" NPT FOR FUEL LEVEL GAUGE
2	3/8" NPT FUEL INLET TO PUMP
3	1 1/2" x 1" NPT ENGINE FUEL SUPPLY
4	1 1/2" x 1" NPT ENGINE FUEL RETURN
5	1" NPT PIPE STEMS FOR ENGINE SUPPLY & RETURN
6	1" NPT OVERFLOW TO MAIN STORAGE TANK
7	2" NPT VENT FOR TANK TO ATMOSPHERE
8	3/8" NPT DRAIN FOR TANK (PLUGGED)
9	6 1/2" X 6 1/2" INSPECTION PLATE
10	PUMP AND ALARM SENSORS
11	CONTROL PANEL
12	REMOVEABLE COVER
13	FUEL INLET THRU COVER
14	ELECTRICAL INLET THRU COVER
15	4" x 4" 7 GAUGE LIFTING LUG
18	NPT FOR OPTIONAL LEAK DETECTOR
22	2" NPT VENT FOR DOUBLE WALL TO ATMOSPHERE
23	1/4" NPT DOUBLE WALL INSPECTION FITTING
24	3/8" NPT DOUBLE WALL DRAIN (PLUGGED)

ADDITIONAL EQUIPMENT FOR U/L LISTED

20	NPT EMERGENCY RELIEF VENT FOR TANK (SEE CHART FOR SIZE)
21	NPT EMERGENCY RELIEF VENT FOR DOUBLE WALL (SEE CHART)

CONSTRUCTION NOTES

TANK TOP,BOTTOM & SHELL-12 GAUGE STEEL
DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE

DAY TANK
PY10-PY25 (10 - 25 GALLONS)
WITH DOUBLE WALL



DRAWN BY: RES	SEE DRAWING: NONE
CHECKED BY: DJW	SCALE: NONE
DATED: 7-21-2000	DWG. NUMBER: STD-A DW

CONSULT FACTORY FOR STANDARD PY5 (FIVE GALLON TANK CAPACITY) NOT SHOWN