




FRONT VIEW

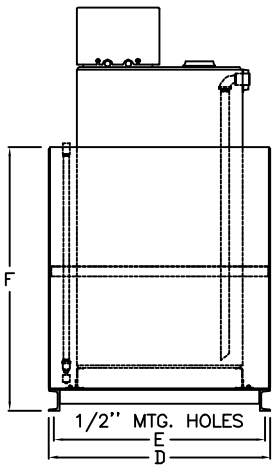


RIGHT SIDE VIEW

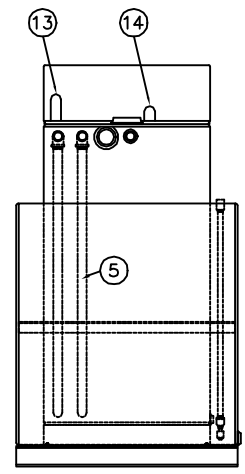

REAR VIEW

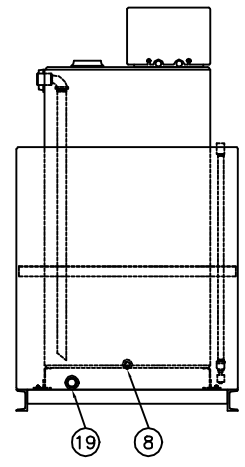

LEFT SIDE VIEW

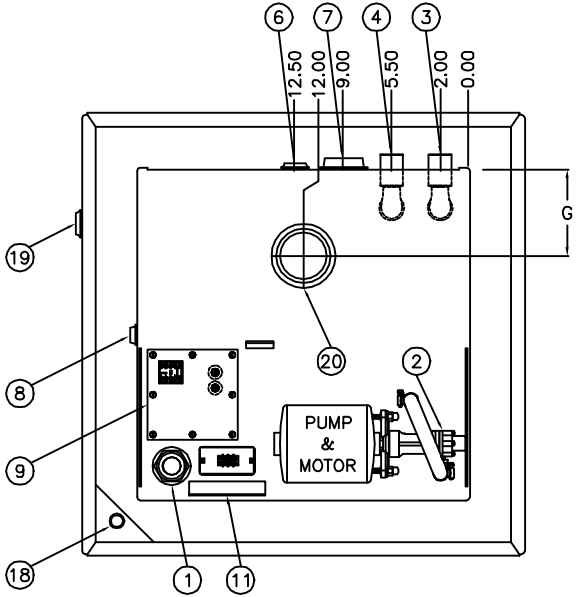

ENLARGED TOP VIEW

DIM.	50 GAL.	60 GAL.	75 GAL.	100 GAL.	150 GAL.
A	36.50	44.50	49.50	49.50	49.50
B	32.00	32.00	32.00	32.00	32.00
C	30.50	30.50	30.50	30.50	30.50
D	26.00	26.00	26.00	32.00	44.00
E	24.50	24.50	24.50	30.50	42.50
F	25.00	29.00	36.00	38.00	41.00
G	3.00	3.00	3.00	6.00	18.00
VENT	2"	3"	3"	3"	3"

DESCRIPTION OF STANDARD EQUIPMENT	
1	1 1/2" NPT FOR FUEL LEVEL GAUGE
2	3/8" NPT FUEL INLET TO PUMP
3	1 1/2" X 1" NPT ENGINE FUEL SUPPLY W/PIPE STEM
4	1 1/2" X 1" NPT ENGINE FUEL RETURN W/PIPE STEM
5	1" NPT PIPE STEMS FOR ENGINE FUEL SUPPLY & RETURN
6	1" NPT OVERFLOW TO MAIN STORAGE TANK
7	2" NPT ATMOSPHERIC VENT FOR TANK
8	3/8" NPT TANK DRAIN
9	6 1/2" X 6 1/2" REMOVABLE INSPECTION PLATE
10	PUMP AND ALARMS SENSORS
11	LOCAL CONTROL PANEL
12	REMOVABLE COVER
13	FUEL INLET TO PUMP THRU REMOVABLE COVER
14	ELECTRICAL INLET THRU REMOVABLE COVER
18	1/2" NPT FOR OPTIONAL RUPTURE BASIN LEAK DETECTOR
19	1" NPT RUPTURE BASIN DRAIN

ADDITIONAL EQUIPMENT FOR U/L LISTED	
20	U/L EMERGENCY RELIEF VENT FOR TANK (SEE CHART FOR SIZE)

CONSTRUCTION NOTES	
TANK TOP,BOTTOM & SHELL - 12 GAUGE	
RUPTURE BASIN BOTTOM & SHELL - 12 GAUGE	
DIMENSION SUBJECT TO CHANGE WITHOUT NOTICE	

DAY TANK
 PY50 - PY150 (50 - 150 GALLONS)
 WITH RUPTURE BASIN



DIMENSIONS IN INCHES	DRAWN BY: RES	SHEET NO: 1 OF 1
	CHECKED BY: D.J.W.	SCALE: 1 = 25
	DATE: 07-21-2000	DWG NUMBER: STD-B SW RB