

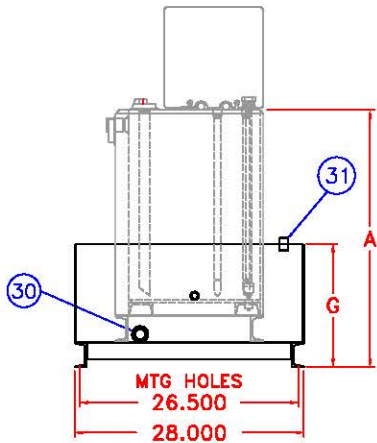


PLAN VIEW

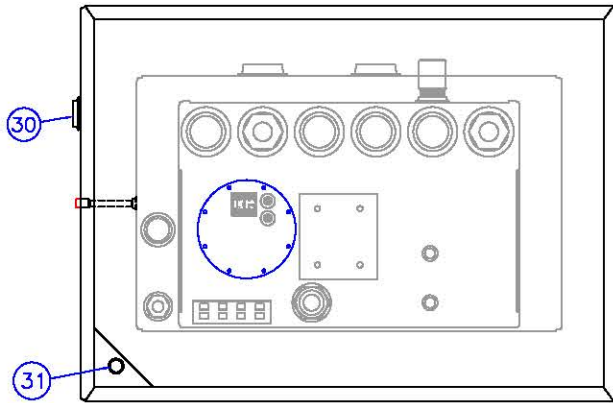

LEFT SIDE VIEW

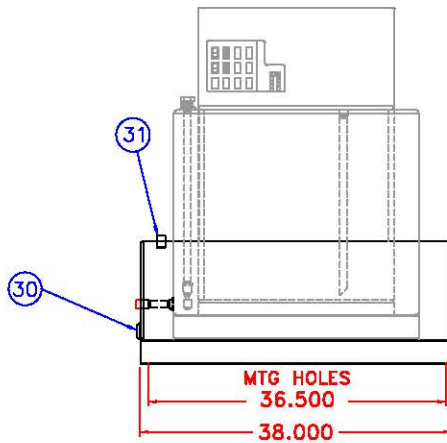

FRONT VIEW

**TANK DIMENSION REFERENCE CHART
(SHOWN IN INCHES)**

TANK RATED CAPACITY	A - HEIGHT (TANK SIZE)	G - HEIGHT (RUPTURE BASIN)	U/L VENT NPT SIZE	WEIGHT * (R/B ONLY)
10 GAL.	20.00	10.00	2.00	87 LBS
15 GAL.	26.00	10.00	2.00	87 LBS
25 GAL.	31.00	15.00	2.00	108 LBS

* Approximate Weight - Rupture Basin (R/B) Only (No Options)

ACTUAL DAY TANK LIGHTENED TO EMPHASIS RUPTURE BASIN

MINIMUM CAPACITY OF SECONDARY CONTAINMENT (RUPTURE BASIN & DOUBLE WALL AREAS) IS 200% OF THE INNER TANK CAPACITY

REF# DESCRIPTION OF STANDARD EQUIPMENT

30	1" NPT - RUPTURE BASIN DRAIN
31	1/2" NPT - FOR OPTIONAL LEAK DETECTOR

CONSTRUCTION NOTES

- 1 - TANK TOP, BOTTOM, & SHELL - 12 GAUGE STEEL
- 2 - DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE

RUPTURE BASIN - OPTION #386
Containment of 200% Minimum Liquid Capacity of Standard & Manual Day Tanks

PY10 - PY25, (Standard Tanks)
PY10M - PY25M (Manual Tanks)
PY10UL - PY25UL (U/L Listed - Standard)
PY10MUL - PY25MUL (U/L Listed - Manual)



PRYCO, INC.

MECHANICSBURG, ILLINOIS

DRAWN BY: *RES* | DATE: 03/01/2008

CHECKED BY: *DW* | REV: 03/01/2008

SHEET NO. 1 of 1 | DWG #: RB_200_A

**200% Rupture Basins For Standard & Manual Day Tanks
With 10 To 25 Gallons Capacity**