


PLAN VIEW
(SCALE: 2X)

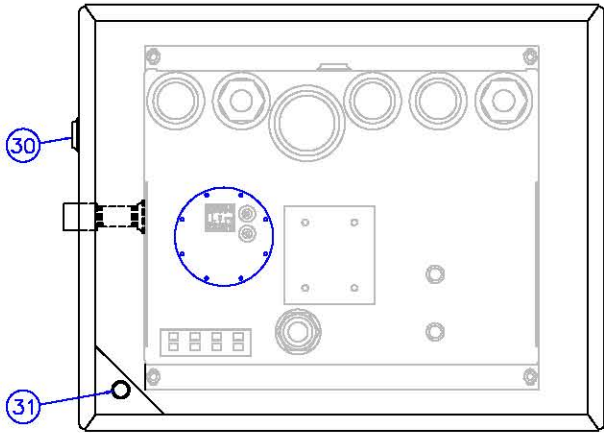


TANK DIMENSION REFERENCE CHART (SHOWN IN INCHES)


TANK RATED CAPACITY	A - HEIGHT * (TANK)	D - DEPTH ** (OVERALL)	E - MTG HOLES (CTR-TO-CTR)	F - DEPTH ** (INNER TANK)	G - HEIGHT * OF R/B
50 GAL.	36.50	26.00	24.50	18.00	27.50
60 GAL.	44.50	26.00	24.50	18.00	30.50
75 GAL.	49.50	26.00	24.50	18.00	37.50
100 GAL.	49.50	32.00	30.50	24.00	37.50
150 GAL.	49.50	44.00	42.50	36.00	37.50

* Height dimension - TANK = Inner Tank (Top to Floor); R/B = Rupture Basin (Top to Floor)
 ** Depth dimension - Front-to-Back

ACTUAL DAY TANK LIGHTENED TO EMPHASIS RUPTURE BASIN
 (Refer To Drawing #STD_SW_B On Page 10 For Standard Day Tank Dimensions and to Drawing #MAN_SW_B On Page 16 For Manual Day Tank Dimensions)

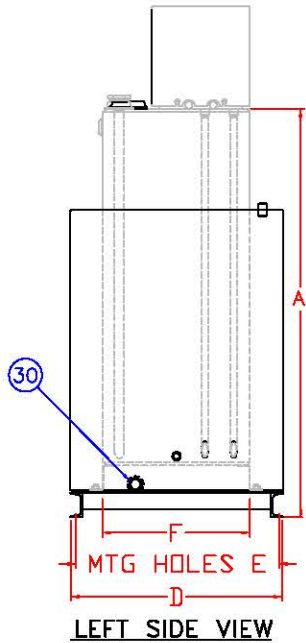

LEFT SIDE VIEW

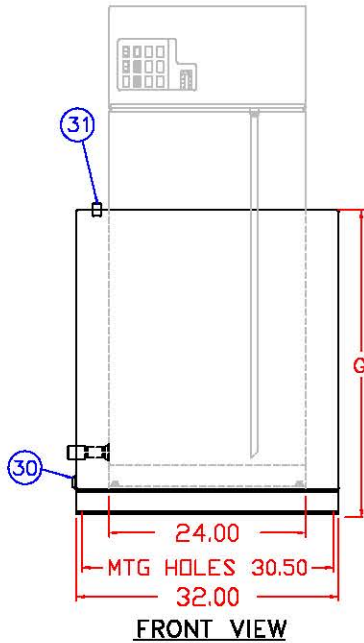

FRONT VIEW

REF#	DESCRIPTION OF STANDARD EQUIPMENT
30	1" NPT - RUPTURE BASIN DRAIN
31	1/2" NPT - FOR OPTIONAL LEAK DETECTOR

CONSTRUCTION NOTES	
1 -	RUPTURE BASIN BOTTOM, & SHELL - 12 GAUGE STEEL
2 -	DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE

RUPTURE BASIN - OPTION #385
 Containment of 150% Minimum Liquid Capacity of Standard or Manual Day Tank

PY50 - PY150, (Standard Tanks)
 PY50M - PY150M (Manual Tanks)
 PY50UL - PY150UL (U/L Listed - Standard)
 PY50MUL - PY150MUL (U/L Listed - Manual)

PRYCO, INC.
 MECHANICSBURG, ILLINOIS

DRAWN BY: <i>RBS</i>	DATE: 03/01/2008
CHECKED BY: <i>DW</i>	REV: 03/01/2008
SHEET NO. 1 of 1	DWG #: RB_150_B

150% Rupture Basins For Standard & Manual Day Tanks
With 50 To 150 Gallons Capacity