



PLAN VIEW
SCALE = 2X

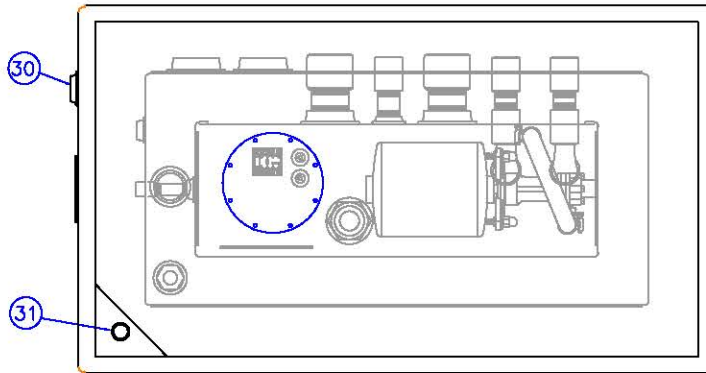


ACTUAL DAY TANK LIGHTEN TO EMPHASIS RUPTURE BASIN
(Refer To Drawing #TRM_DW_A On Page 23 For Day Tank Dimensions)

MINIMUM CAPACITY OF SECONDARY CONTAINMENT (RUPTURE BASIN AREA) IS 200% CAPACITY OF THE INNER TANK

LEFT SIDE VIEW

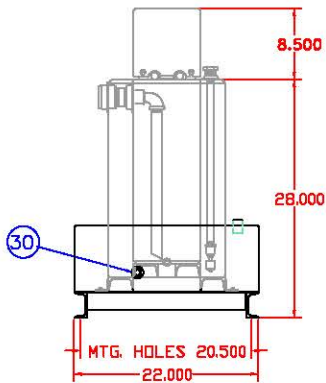

FRONT VIEW

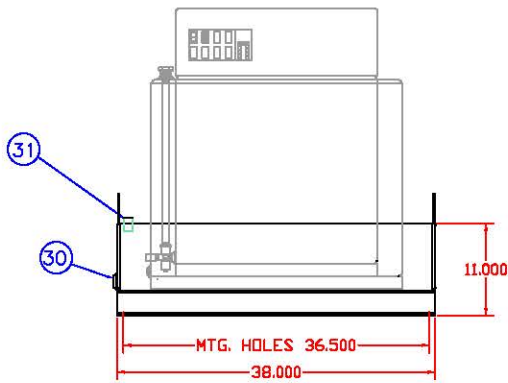

REF#	DESCRIPTION OF STANDARD EQUIPMENT
30	1" NPT - RUPTURE BASIN DRAIN
31	1/2" NPT - FOR OPTIONAL LEAK DETECTOR

CONSTRUCTION NOTES
1 - TANK TOP, BOTTOM, & SHELL - 12 GAUGE STEEL
2 - DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE

RUPTURE BASIN - OPTION #386
Containment of 200% Minimum Liquid Capacity
of Trim Day Tanks

PY10T (Standard Tanks)
PY10TUL (UL Listed - Standard)

PRYCO, INC.
MECHANICSBURG, ILLINOIS

DRAWN BY: RES	DATE: 03/01/2008
CHECKED BY: DTW	REV: 03/01/2008
SHEET NO. 1 of 1	DWG #: RT_200_A